

Ксә
@# K ç0ñV8Ya Z
1. yYV6z Bx0 z1 2
+0Y
+Y
+11

CHINT 中自 010101

11 11 11 11


1111 11 11

1111 2222 3333 4444 5555
1111 2222 3333 4444 5555



1111 2222 3333 4444 5555 6666 7777 8888 9999 101011
1111 2222 3333 4444 5555 6666 7777 8888 9999 101011

ž "TÛ X

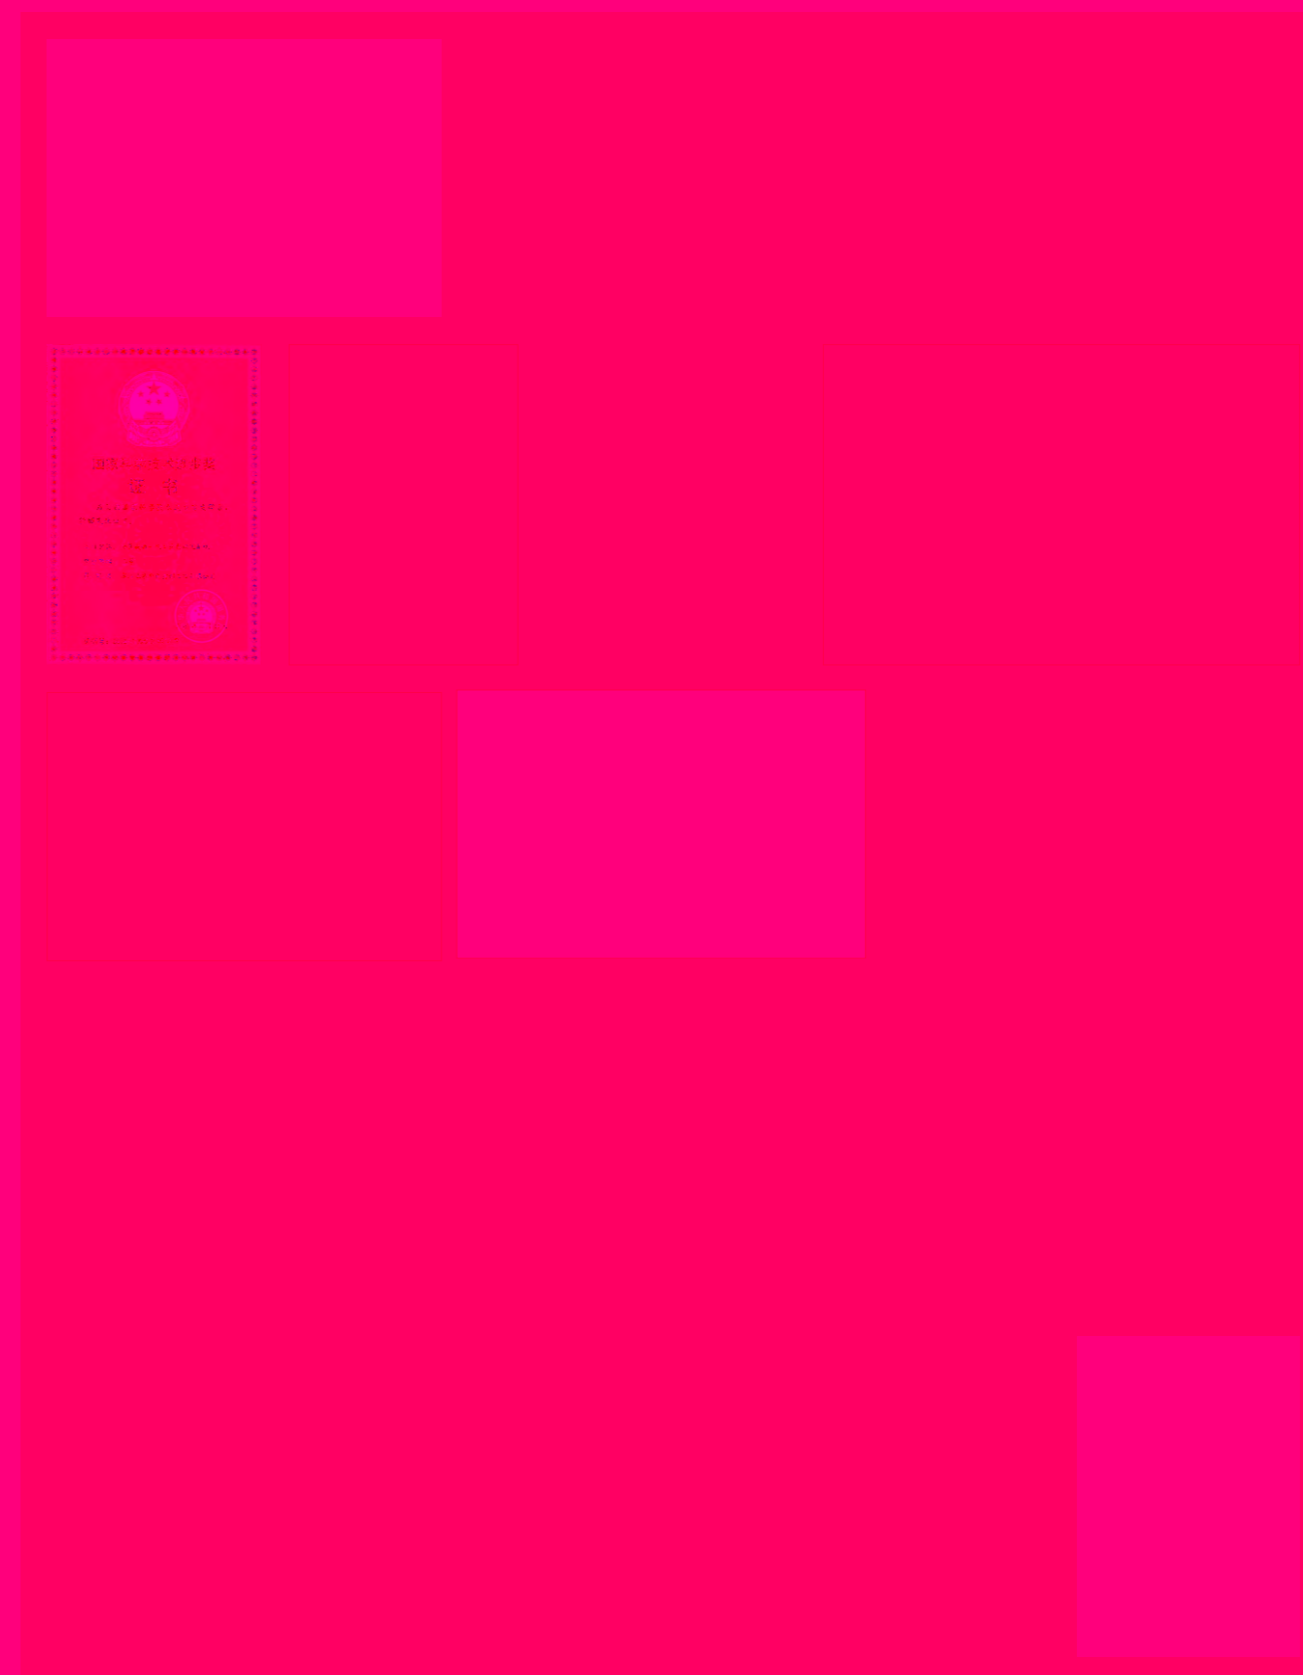

· Z ^ O



· - ë J+ £

x ž é

x ž x B 4i

¶ É •

ä 4 è

8/16/32 I/O I/O I/O

ä U ´

IEC 61000

CE

ANSI/ISA 71.04 G3

ä ¶

ISA Secure/IEC 62443

• y Á


Modbus Profibus FF HART

£ Á

x ž — Ä



00{

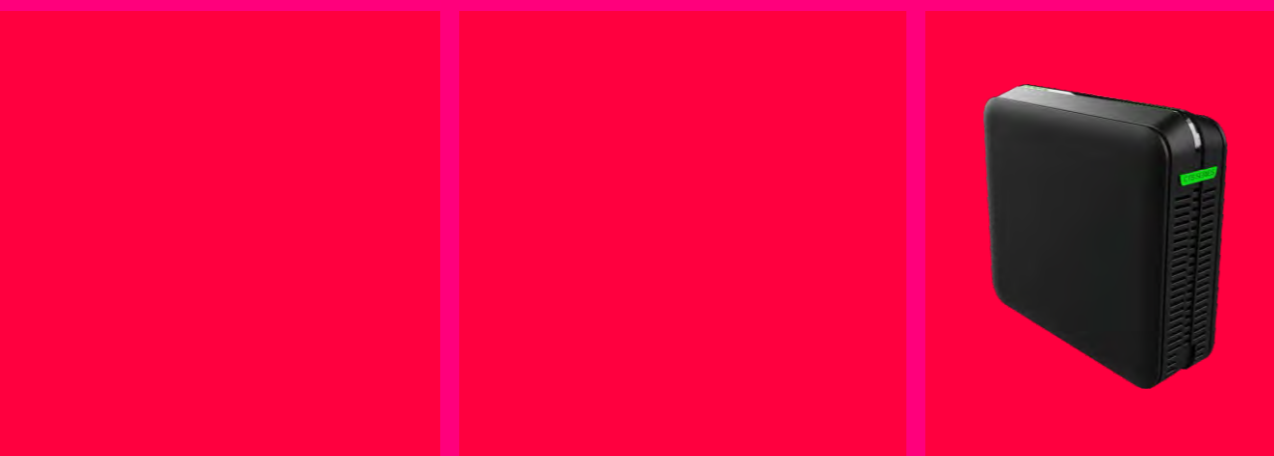

q•t{ Wid{



f G Æ ~

*'à]



0 ñ J • É

È ç è ã




CBUS POWERLINK

CBUS
CBUS


100Mbps

CBUS

8

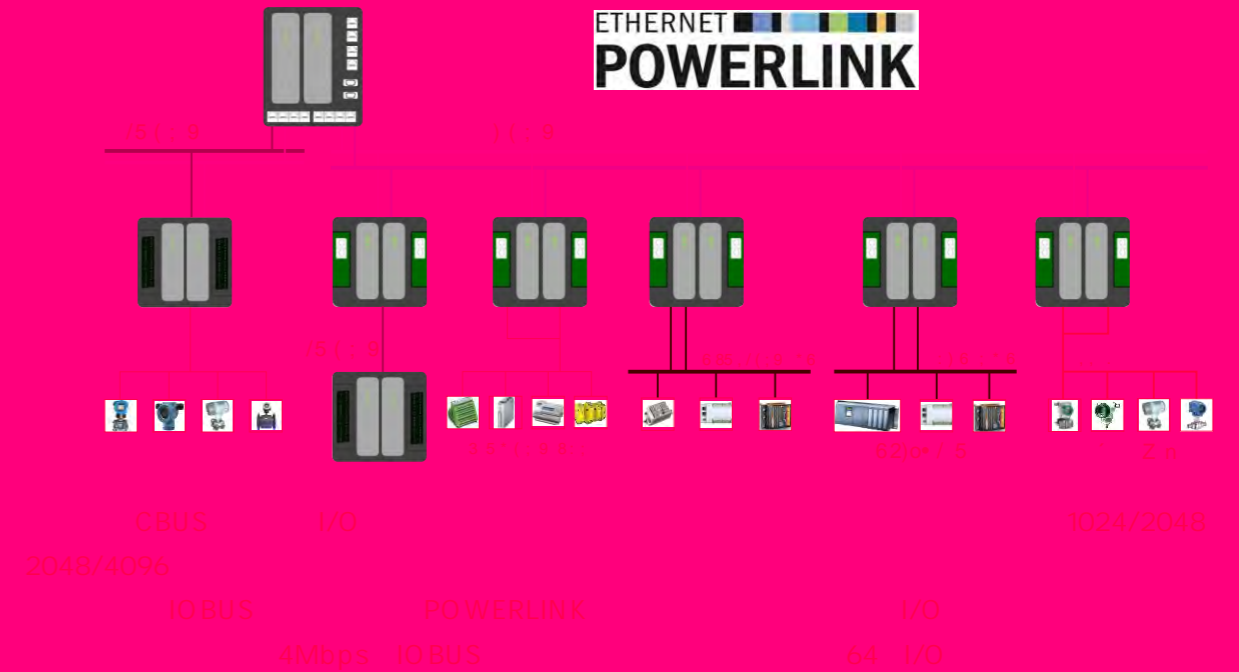

B ^

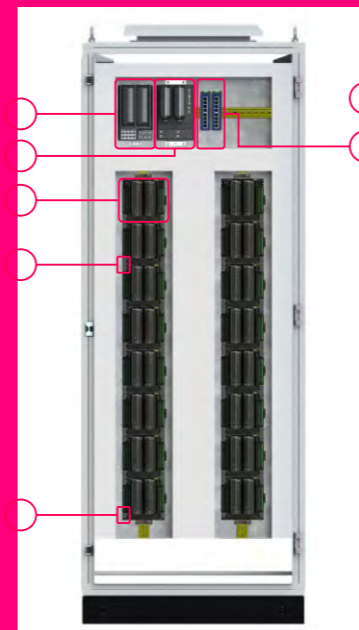

• Z / L

- 1 I/O MODBUS-TCP
- 2 MODBUS-TCP
- 3 OPC DDE

35*(;9;)6RÑ



CT9161 MODBUS-TCP HMI

) : k¿NM ò y





56)0* ** +

- OPC
- DDE
- DDE EXCEL
- OPC DDE
- OPC DDE



x ž •] æ =

O ò { F ^

O ò %²) :	+ZNKXTK¿494KZ# 'ò*35* (;9)6RÑ k%² ' É*Faož	
é Y ' Z ÿ µ %²) :	µ µ æ Y k u 4 9 o * v ' ò Ö ' Z ÿ µ k , S ' ' < *) S ' ' ' Z * ' o z u 4 É *	
é % c ÿ µ %²) :	µ µ æ Y k u 4 (o * + o * 0 o * 1 o * 9 o * 9) % c o z u 4 É *	
é % Š ÿ µ %²) :	µ µ æ Y k u 4 % Š ' Z ÿ µ k ,) [y 6 Z _ ' Z * ' o z u 4 É *	
é v ÿ B %²) :	µ µ æ Y k u 4 v ' Z ÿ B k , % S ' o * % S ' _ ' Z * ' k U Y y G F a j L k ' ' o Ö N ' é f G y B ' 4 é y B — ' o z u 4 É *	
é f O ÿ µ %²) :	< *) ò µ 9 k u 4 A ' o * — y f O y µ o z u 4 É *	
é f O ÿ B %²) :	< *) ²) f O y B o z u 4 É *	
) :	U ' é / 5 (; 9 µ µ ð u É z A E ' ò k / 5 % * U ' É z ' k %² ' É * F a o z / 5 (; 9 %² x ' / 5 (; 9 %² , k ? O ó (- Á F a o z	
) (; 9 %²) :	U ' é O ò É z A E ' ò k ' ' % < * ' A E k %² ' É * F a o z e - j N ' ' %² 2 % %² . Á F a o z	
/ 5 y J ' ' %²) :	é / 5 y J	